


PROJECT #:	WAPR17
DATE:	12/5/17
DRAWN:	MEO
CHECKED:	DRD


REVISIONS	
1	BID ADDENDUM #1 12/27/17

M7.5

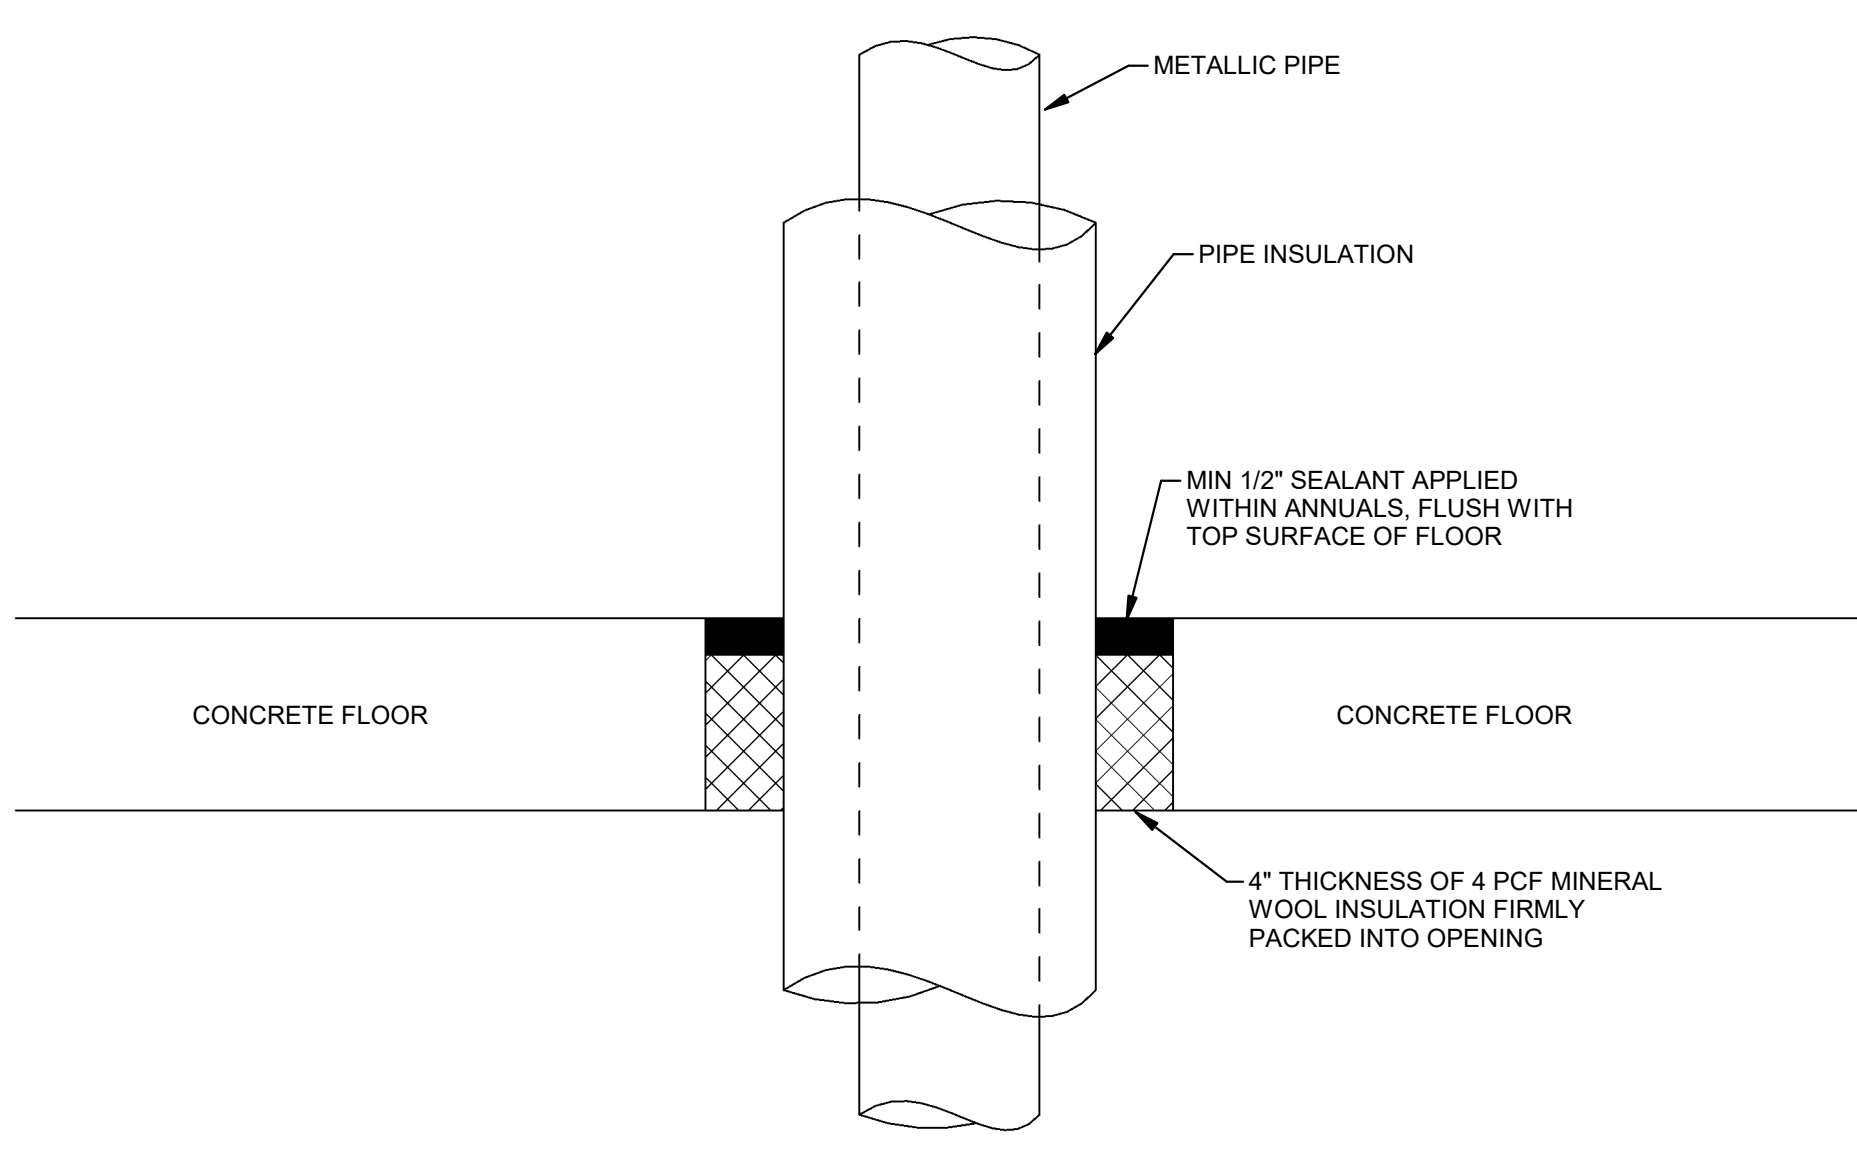


**DETAIL NOTES:**  
1. WHERE FLOOR MAINTAINS A FIRE-RESISTANCE RATING, PROVIDE SEALANT IN ACCORDANCE WITH APPLICABLE UL RATING AND DETAIL REQUIREMENTS.


**1 PIPE FLOOR PENETRATION DETAIL**  
SCALE: NONE

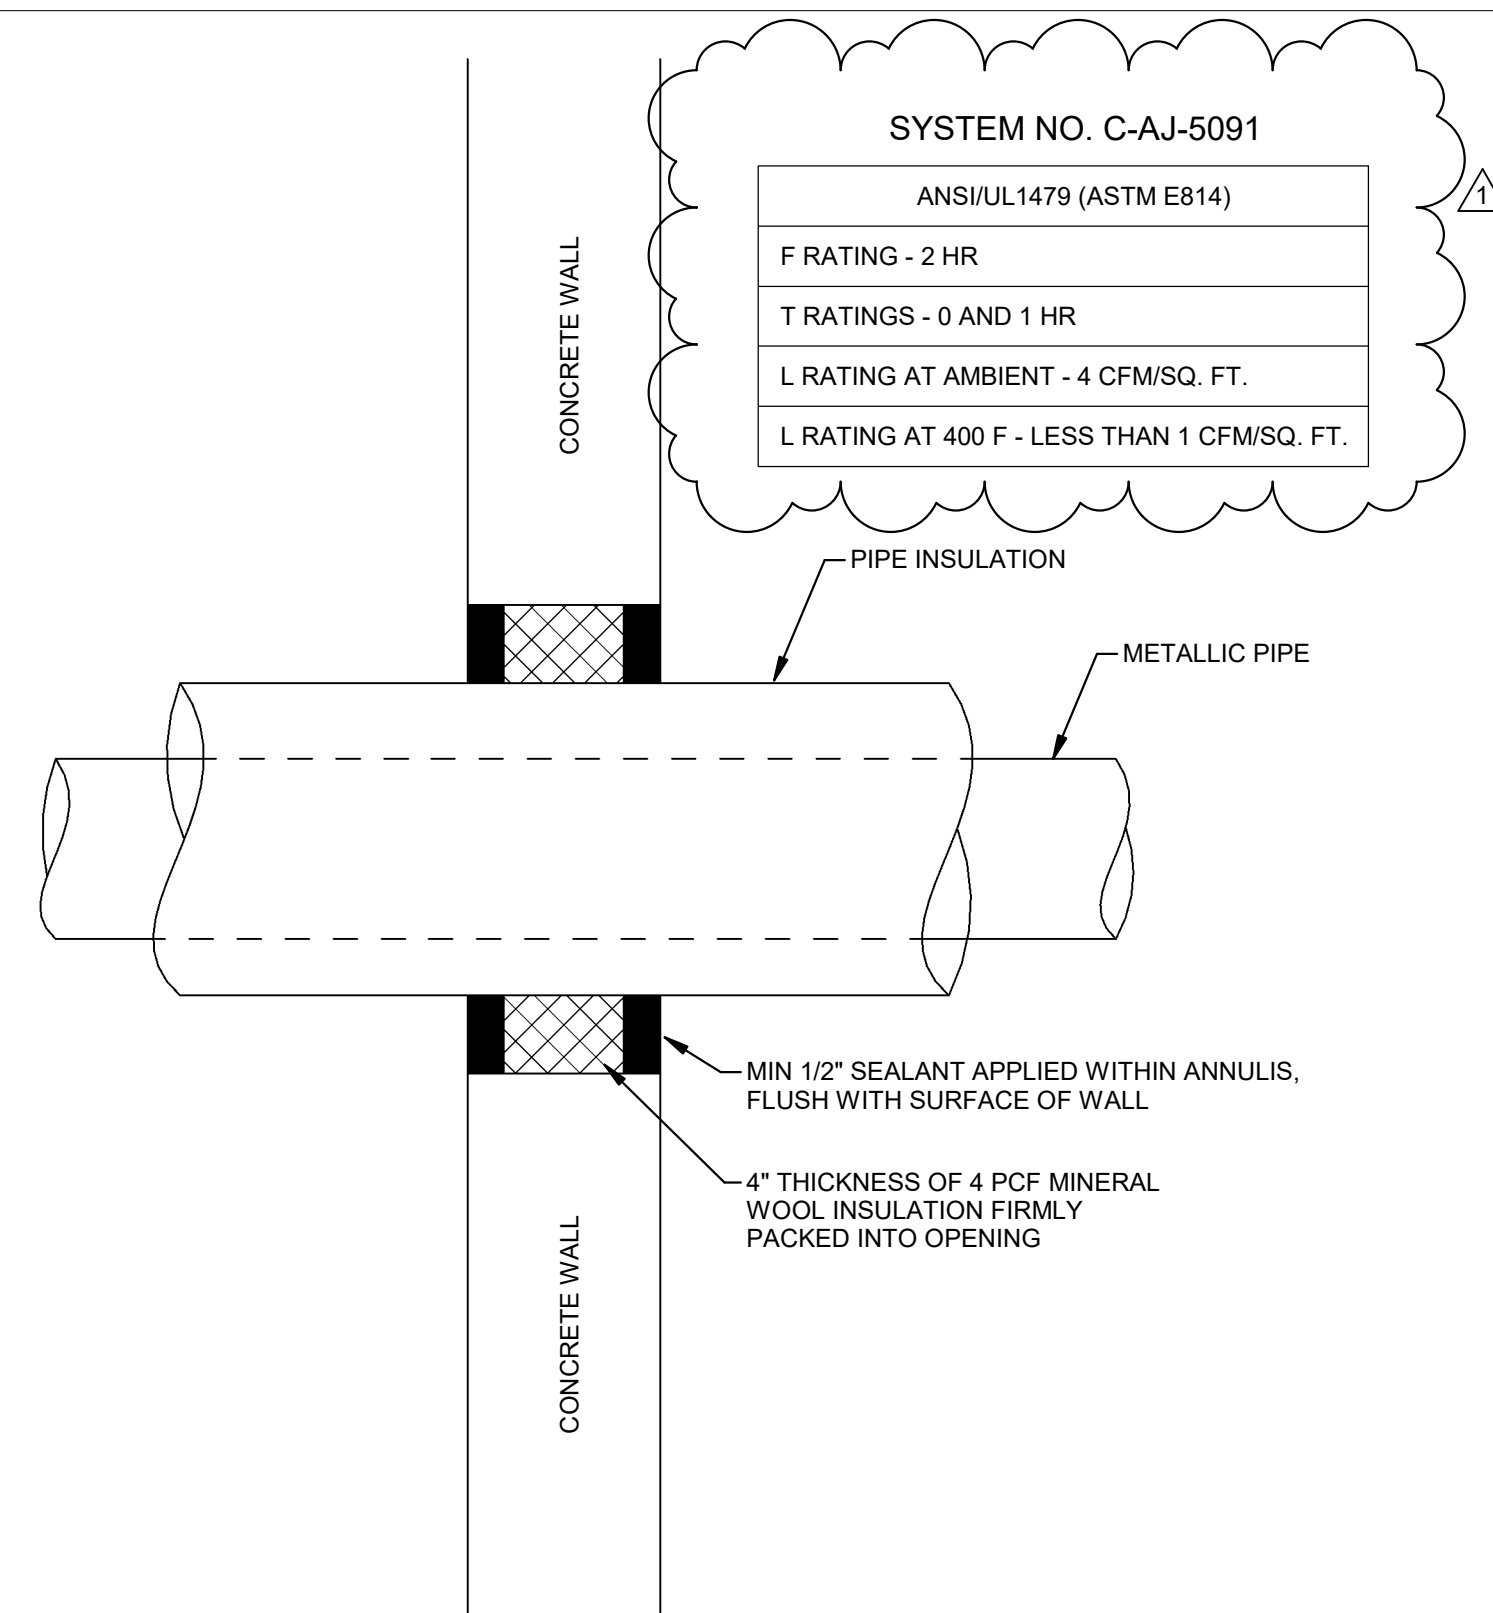


**2 INTERIOR RATED WALL PIPE PENETRATION DETAIL**  
SCALE: NONE

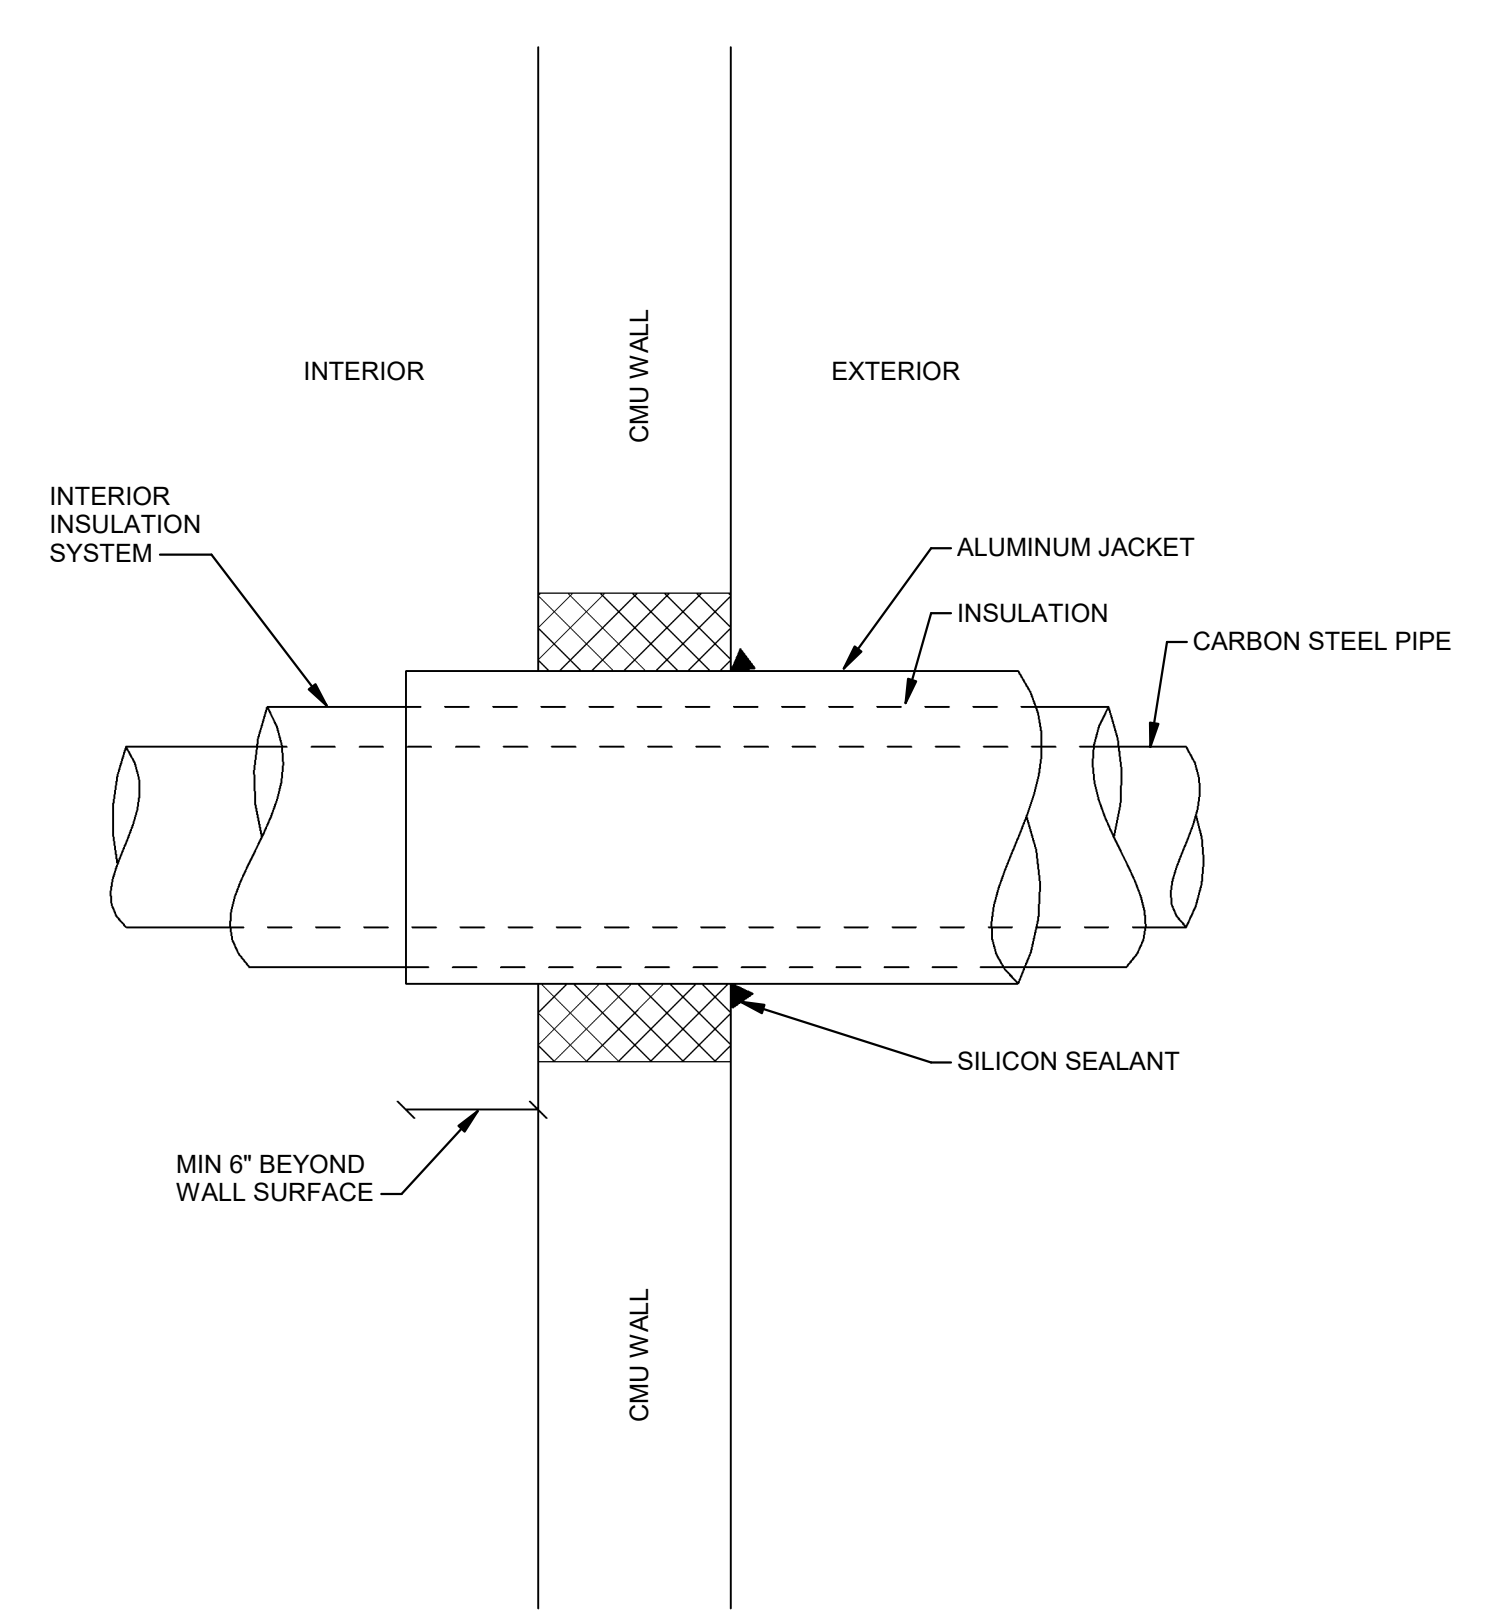


**3 EXTERIOR WALL PIPE PENETRATION DETAIL**  
SCALE: NONE

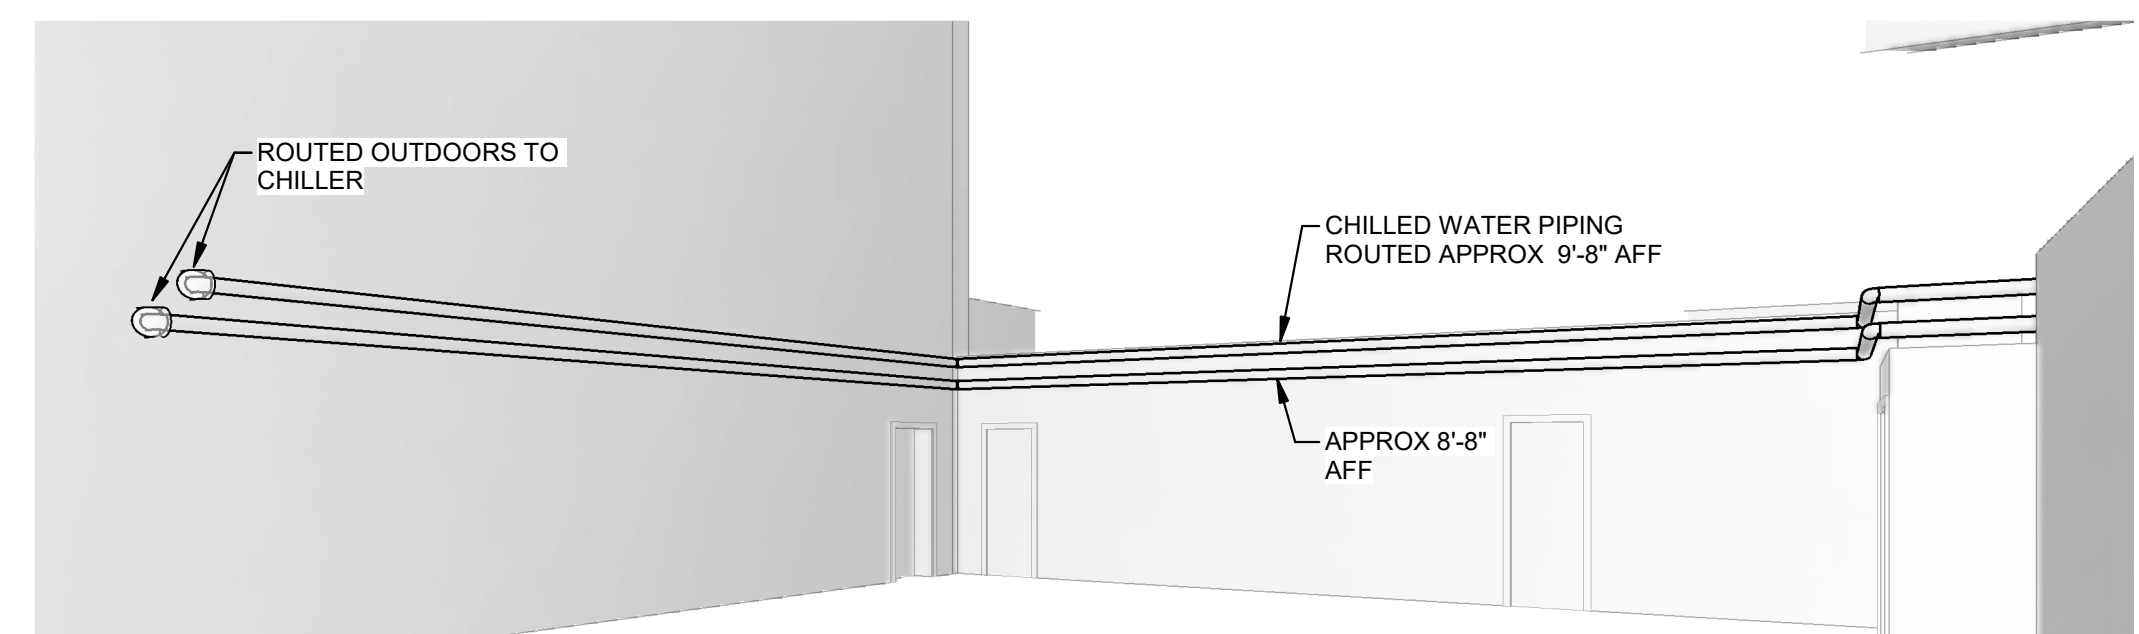


**6 CAFETERIA PIPE ROUTING**  
SCALE: NONE

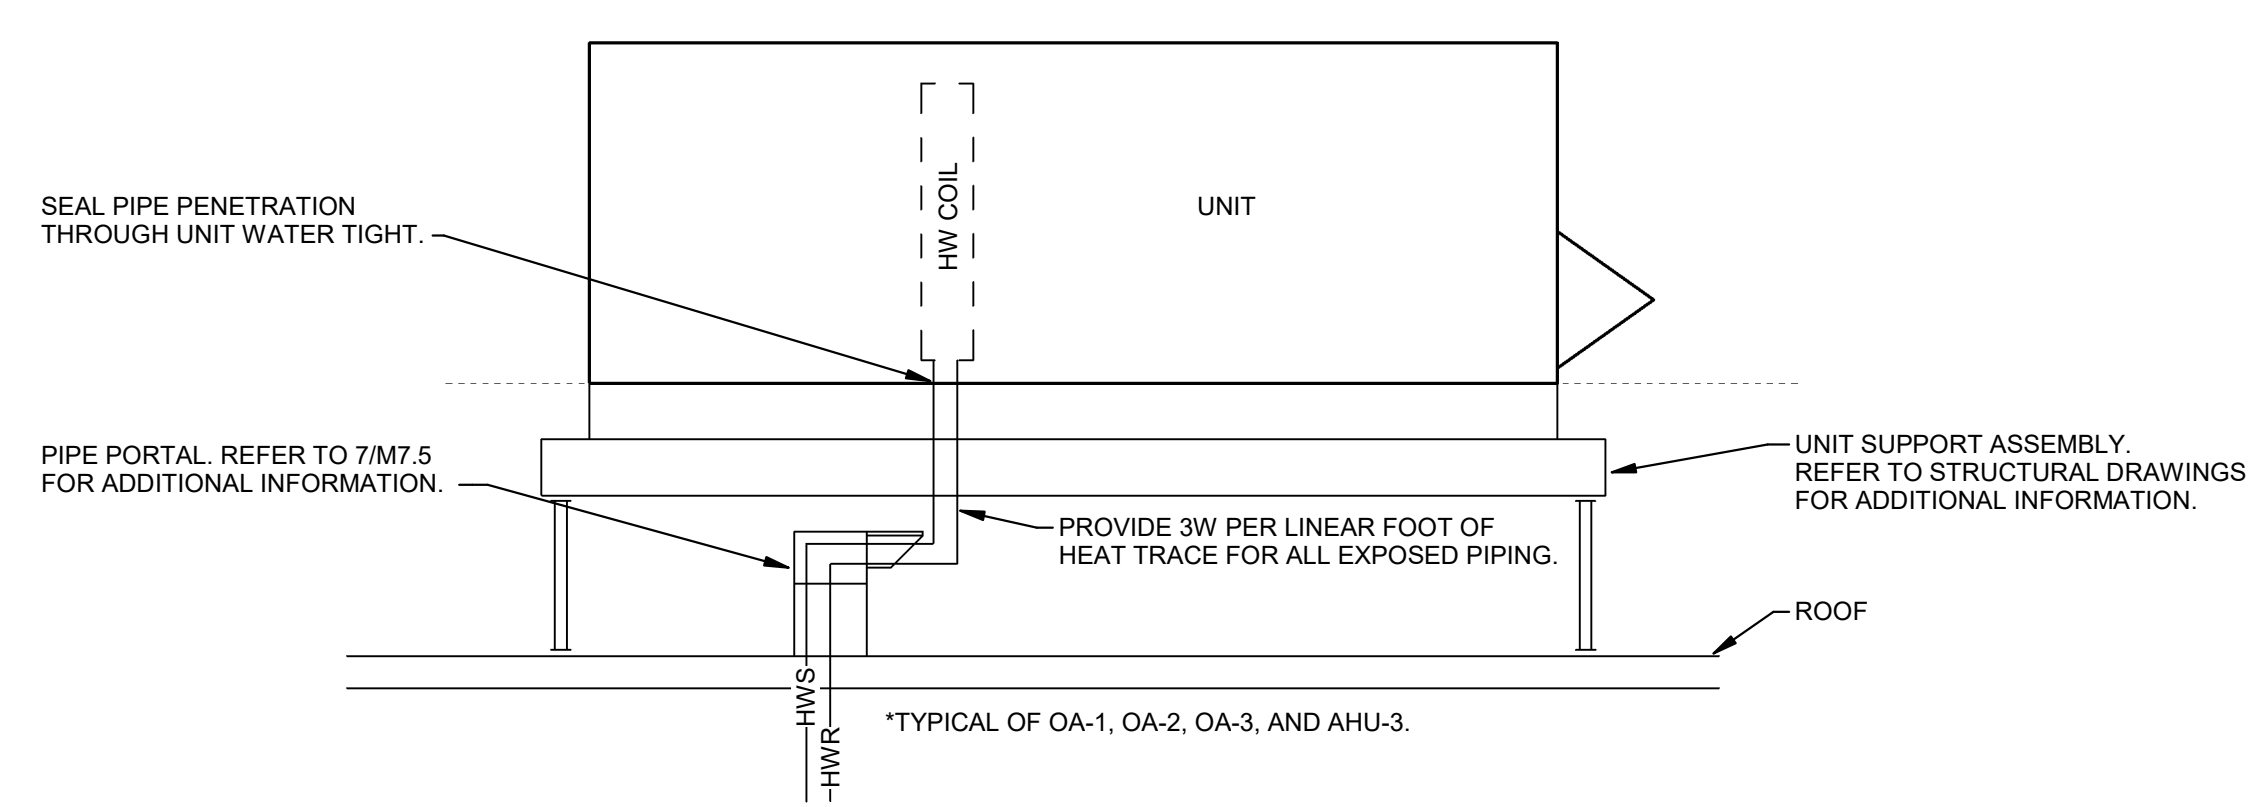

**5 ROOFTOP UNIT HOT WATER COIL CONNECTION DETAIL**  
SCALE: NONE

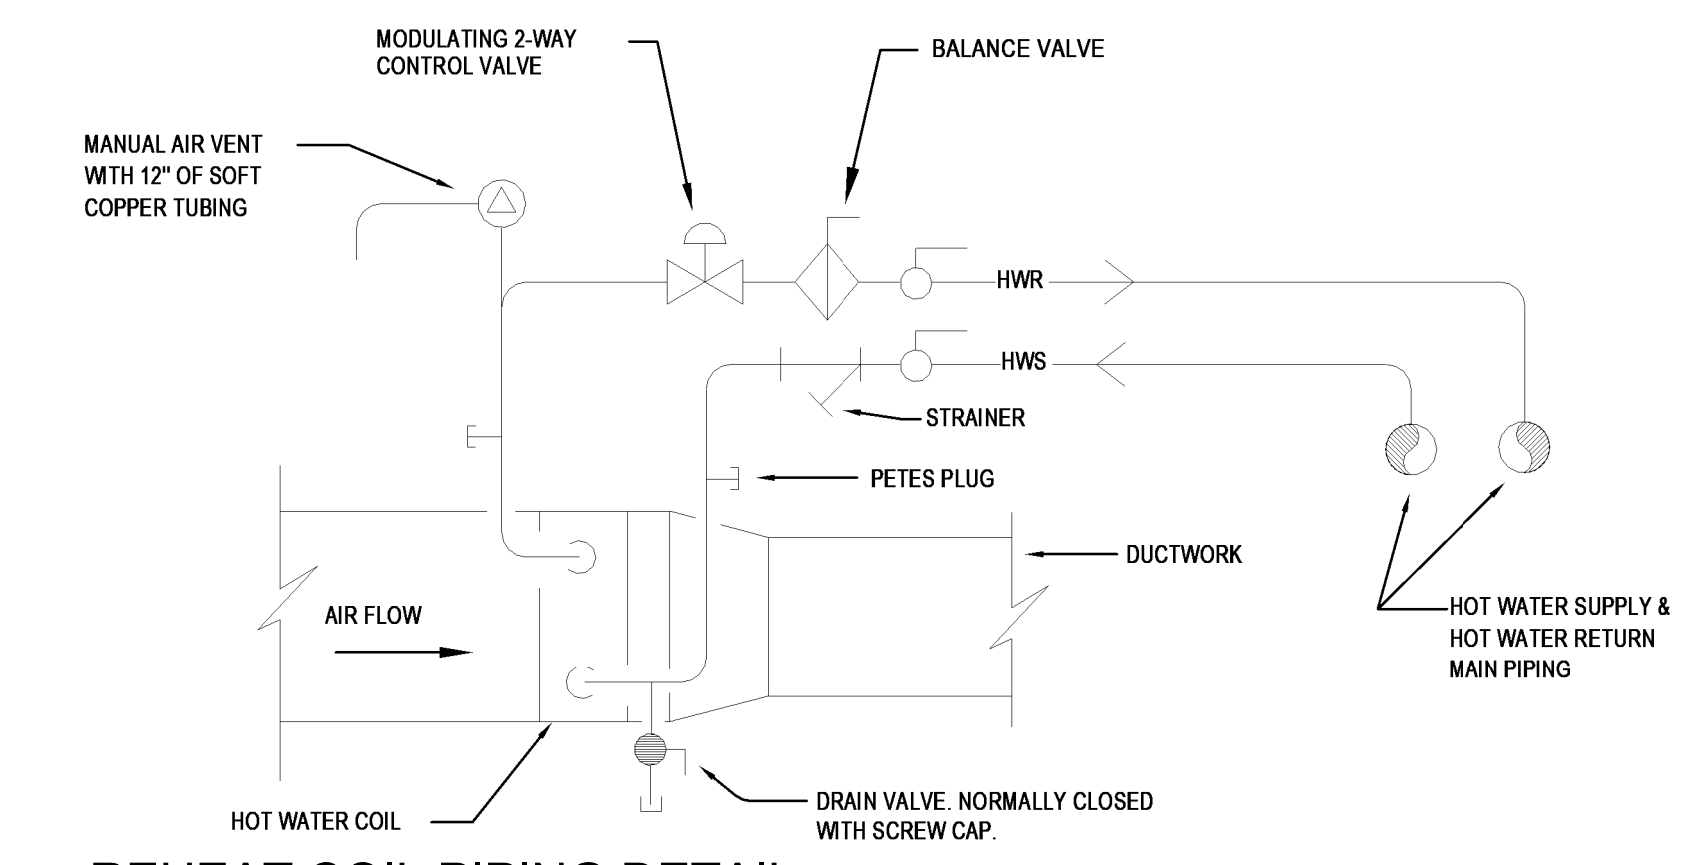

**4 REHEAT COIL PIPING DETAIL**  
SCALE: NONE

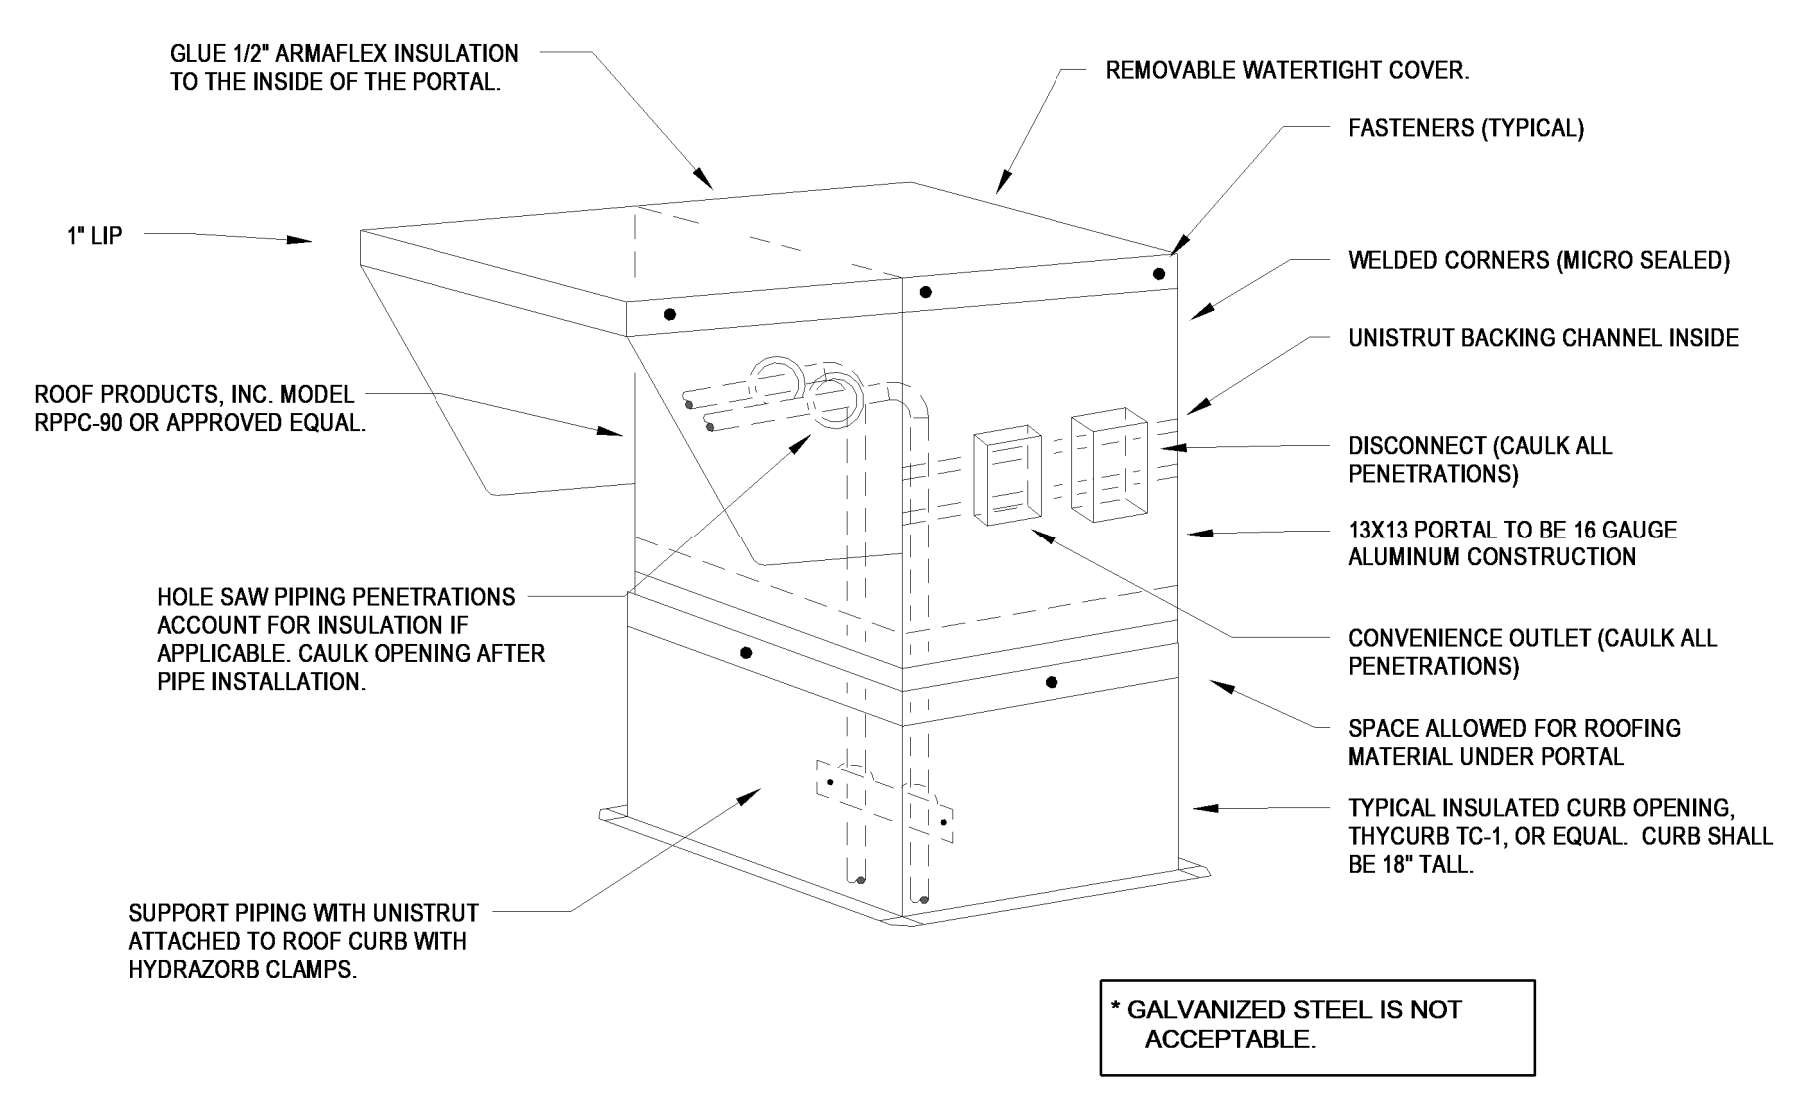

**7 PIPE HOOD DETAIL**  
SCALE: NONE